

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments

★ ★ ★
★ Designated
according to
Article 29 of Regula-
tion (EU) No 305/2011
and member of EOTA
(European Organi-
sation for Technical
Assessment)
★ ★ ★
★ ★

European Technical Assessment

ETA-11/0240
of 21 December 2021

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Trade name of the construction product

Product family
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment
contains

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

This version replaces

Deutsches Institut für Bautechnik

Nail Anchor N

Fastener for use in concrete for redundant non-structural
systems

MKT
Metall-Kunststoff-Technik GmbH & Co. KG
Auf dem Immel 2
67685 Weilerbach
DEUTSCHLAND

MKT
Metall-Kunststoff-Technik GmbH & Co. KG
Auf dem Immel 2
67685 Weilerbach
DEUTSCHLAND

11 pages including 3 annexes which form an integral part
of this assessment

EAD 330747-00-0601 Edition 06/2018

ETA-11/0240 issued on 7 May 2015

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

European Technical Assessment

ETA-11/0240

English translation prepared by DIBt

Page 3 of 11 | 21 December 2021

Specific Part

1 Technical description of the product

The Nail Anchor N is a fastener made of galvanized or stainless steel which is placed into a drilled hole and expanded by loading.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C2

3.2 Safety in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance for all load directions and modes of failure for simplified design	See Annex B2 and C1
Durability	See Annex B1

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330747-00-0601, the applicable European legal act is: [97/161/EC].

The system to be applied is: 2+

European Technical Assessment

ETA-11/0240

English translation prepared by DIBt

Page 4 of 11 | 21 December 2021

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 21 December 2021 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Lange

Nail Anchor N

Installation condition and fastener versions

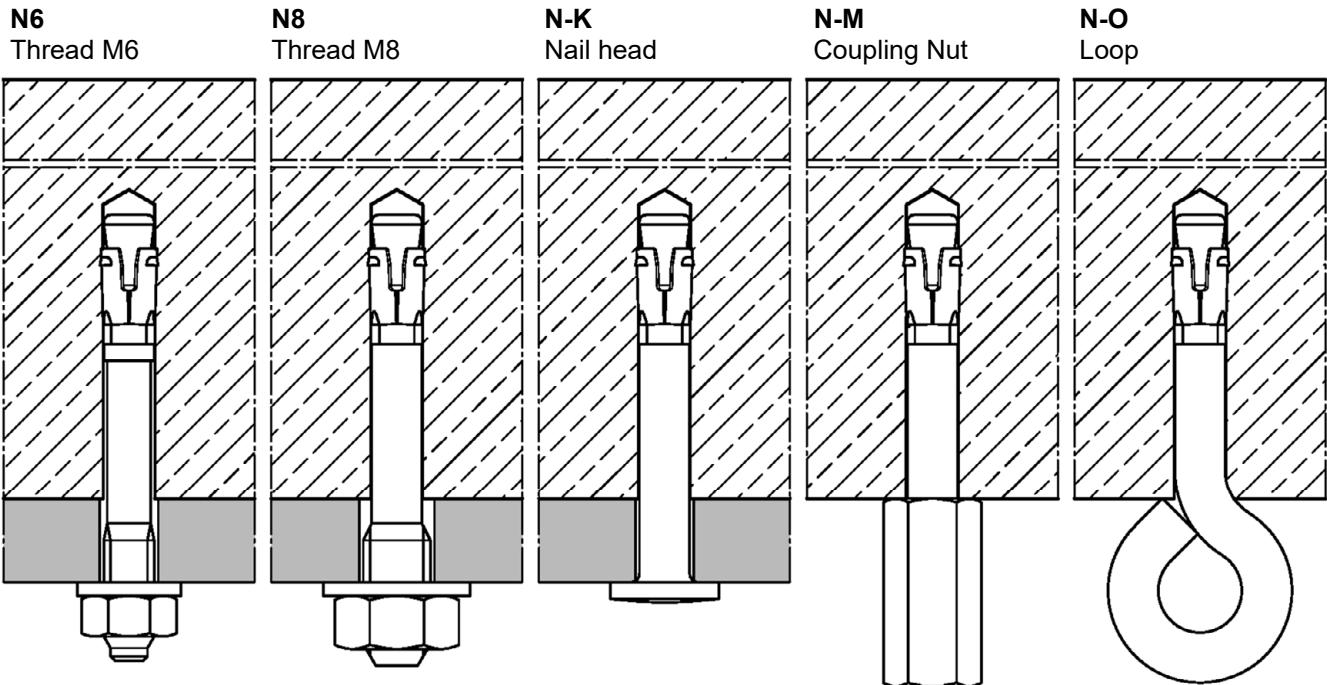

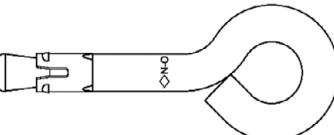


Table A1: Materials

Designation	Steel zinc plated	Stainless steel CRC III	High corrosion resistant steel CRC V
Conical bolt	Steel, galvanized $\geq 5 \mu\text{m}$, fracture elongation $A_5 \geq 8 \%$	Stainless steel, coated fracture elongation $A_5 \geq 8 \%$	High corrosion resistant steel, coated fracture elongation $A_5 \geq 8 \%$
Expansion sleeve	Stainless steel	Stainless steel	Stainless steel
Washer	Steel, galvanized $\geq 5 \mu\text{m}$	Stainless steel	High corrosion resistant steel
Hexagon nut			
Coupling nut	Steel galvanized $\geq 5 \mu\text{m}$	Stainless steel	High corrosion resistant steel

Marking

Version		Marking (examples)	Explanation
N6 Thread M6		◇ N6 5/10 ◇ N6 5 A4	◇ manufacturer identification
N8¹⁾ Thread M8		◇ N8 5/10 ◇ N8 5 A4	N6 fastener identity with thread size M6 or M8
N-K¹⁾ Nail head		 	5 max. thickness of fixture for $h_{ef} = 30$ mm 10 max. thickness of fixture for $h_{ef} = 25$ mm
N-M¹⁾ Coupling Nut M8/M10 M8/M12		◇ N8 5/10 ◇ N8 5 A4	additional markings: A4 stainless steel HCR high corrosion resistant steel
N-O Loop		◇ N-O	-O fastener version: Loop

¹⁾ optional with torsion protection

Table A2: Length identification

Fastener identifier	Marking		Thickness of fixture	
	all materials	steel, zinc plated	at $h_{ef} =$	
			30 mm	25 mm ¹⁾
A	0 / 5		0	5
B	5 / 10		5	10
C	10 / 15		10	15
D	15 / 20		15	20
E	20 / 25		20	25
F	25 / 30		25	30
G	30 / 35		30	35
H	35 / 40		35	40
I	40 / 45		40	45
J	45 / 50		45	50
K	50 / 55		50	55
L	55 / 60		55	60
M	60 / 65		60	65

¹⁾ for internal use only

Ausführung identifier	Marking		Thickness of fixture	
	all materials	steel, zinc plated	at $h_{ef} =$	
			30 mm	25 mm ¹⁾
N	65 / 70		65	70
O	70 / 75		70	75
P	75 / 80		75	80
Q	80 / 85		80	85
R	85 / 90		85	90
S	90 / 95		90	95
T	95 / 100		95	100
U	100 / 105		100	105
V	105 / 110		105	110
W	110 / 115		110	115
X	115 / 120		115	120
Y	120 / 125		120	125
Z	125 / 130		125	130

Nail Anchor N

Product description

Marking / Length identification

Annex A2

Specifications of intended use

Nail Anchor	N6 Thread M6	N8 Thread M6	N-K Nail head	N-M Coupling nut	N-O Loop
Static or quasi-static action			✓		
Fire exposure			R30 / R60 / R90 / R120		
Cracked or uncracked concrete			✓		
Strength classes C12/15 to C50/60 according to EN 206:2013 + A1:2016			✓		
Compacted, reinforced or unreinforced normal weight concrete, without fibres according to EN 206:2013 + A1:2016			✓		

Use conditions (environmental conditions):	Effective anchorage depth
• Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel)	$h_{ef} \geq 30\text{mm}$ and $h_{ef,red} \geq 25\text{mm}$
• Structures subject to permanently damp internal conditions, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)	$h_{ef} \geq 30\text{mm}$ and $h_{ef,red} \geq 25\text{mm}$
• Structures subject to external atmospheric exposure including industrial and marine environment, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)	$h_{ef} \geq 30\text{mm}$
• Structures subject to external atmospheric exposure and to permanently damp internal conditions, if other particular aggressive conditions exist (high corrosion resistant steel)	$h_{ef} \geq 30\text{mm}$

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used.)

Design:

- Fastenings are designed under the responsibility of an engineer experienced in fastenings and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be fastened. The position of the fastener is indicated on the design drawings (e.g. position of the fastener relative to reinforcement or to supports, etc.).
- Design of fastenings according to EN 1992-4:2018, simplified design method C
- Fasteners are only to be used for redundant non-structural systems.

Installation:


- Drill hole by hammer drilling or vacuum drilling.
- Installation only as supplied by the manufacturer, without replacement of individual parts.
- Fastener installation such that the effective setting depth is complied with. This compliance is ensured, if the admissible thickness of fixture is kept or the loop of Nail Anchor N-O rests on the concrete surface.

Nail Anchor N	Annex B1
Intended Use Specifications	

Table B1: Installation parameters

Fastener type		N6 N-K N-O	N8 N-M	N6 N-K N-O	N8 N-M
Effective anchorage depth	$h_{\text{ef}} \geq$ [mm]		25 ¹⁾		30
Nominal drill hole diameter	d_0 [mm]		6		6
Cutting diameter to drill bit	$d_{\text{cut}} \leq$ [mm]		6,40		6,40
Depth of drill hole	$h_1 \geq$ [mm]		35		40
Diameter of clearance hole in the fixture	$d_f \leq$ [mm]	7	9	7	9
Maximum tightening torque (N 6 and N 8)	$T_{\text{inst}} \leq$ [Nm]		4		4
Minimum member thickness	h_{min} [mm]		80		80

¹⁾ Internal use only

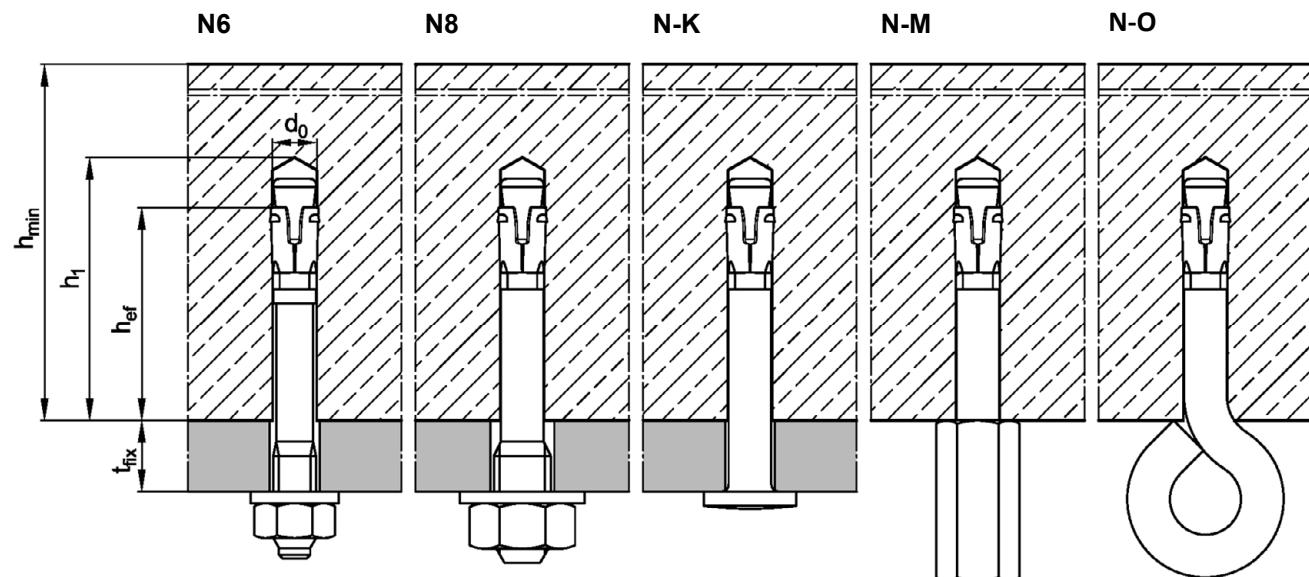

Installation instructions

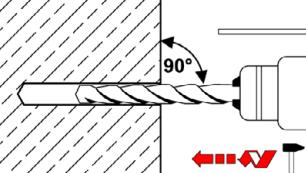
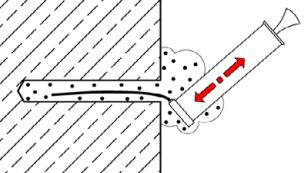
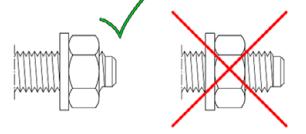
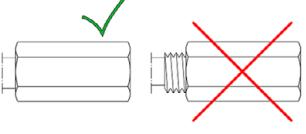
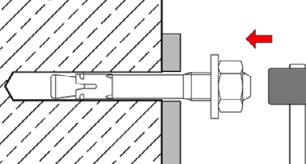
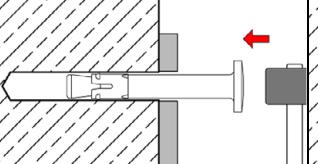
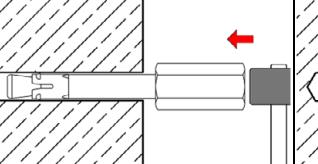
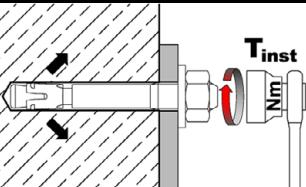
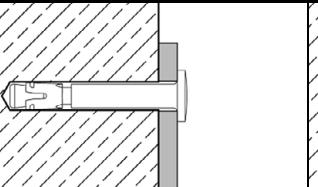
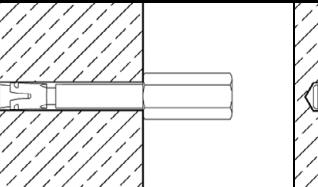
All fastener types				
1		Drill hole perpendicular to the concrete surface by hammer drilling or vacuum drilling.		
2		Blow out dust. Alternatively, vacuum clean down to the bottom of the hole.		
N6 / N8 Thread M6 / M8	N-K Nail head	N-M Coupling nut	N-O Loop	
	-		-	
Check position of nut.				
4				
Drive in fastener.				
5				
Apply installation torque $T_{inst} \leq 4 \text{ Nm}$.		Installation condition		

Table C1: Characteristic resistance for a fixing point¹⁾, all directions, design method C

Fastener type		N6	N8 N-K N-M	N-O	N6	N8 N-K N-M	N-O	
Effective anchorage depth	h_{ef} [mm]	25			30			
Optimized for maximum load								
Characteristic resistance	C12/15	F_{Rk} [kN]	3,0	3,0	1,5	4,0	4,0	
	C20/25 to C50/60		4,5	4,5	1,5	5,9	5,9	
Respective spacing between fixing points ^{1) 2)}	s_{cr} [mm]	100						
	for $c_{\text{cr}} \geq$ [mm]	200						
Respective edge distance ²⁾	c_{cr} [mm]	100						
	for $s_{\text{cr}} \geq$ [mm]	200						
Partial factor	γ_M	-	1,5					
Optimized for minimum edge distance								
Characteristic resistance	C12/15	F_{Rk} [kN]	1,5	1,5	1,5	2,0	2,0	
	C20/25 to C50/60		2,0	2,0	1,5	2,5	2,5	
Respective spacing between fixing points ^{1) 2)}	c_{cr} [mm]	50						
	for $s_{\text{cr}} \geq$ [mm]	100						
Partial factor	γ_M	-	1,5					
Shear load with lever arm								
Characteristic bending resistance, steel, zinc plated	$M^0_{Rk,s}$ [Nm]	9,2	12,7	³⁾	9,2	12,7	³⁾	
Characteristic bending resistance, stainless steel A4 / HCR	$M^0_{Rk,s}$ [Nm]	9,2	13,5	³⁾	9,2	13,5	³⁾	
Partial factor	γ_{Ms}	-	1,25					

¹⁾ A fixing point is defined as:

- Single fastener
- Fastener group with a minimum spacing s of $50 \text{ mm} \leq s < s_{\text{cr}}$

If the spacing in a fixing point is greater than or equal to the respective spacing in this table, the characteristic resistances apply to every single fastener.

²⁾ Intermediate values can be linearly interpolated

³⁾ No performance assessed.

Table C2: Characteristic resistance for a fixing point¹⁾ under fire exposure in concrete C20/25 to C50/60, design method C

Fire resistance class	Fastener type									
	N6 N8	N-K	N-M ³⁾	N-O	N6 N8	N-K	N-M ³⁾	N-O		
Effective anchorage depth h_{ef} [mm]	25				30					
Load in any direction										
R 30	Characteristic resistance, steel zinc plated	$F_{Rk,fi}$ [kN]	0,6	0,6	0,6	0,2	0,9	0,9	0,8	-
R 60			0,6	0,6	0,6	0,2	0,7	0,8	0,7	-
R 90			0,5	0,6	0,6	0,1	0,5	0,6	0,6	-
R 120			0,4	0,5	0,5	0,1	0,4	0,5	0,6	-
R 30	Characteristic resistance, stainless steel A4 / HCR	$F_{Rk,fi}$ [kN]	0,6	0,6	0,6	0,2	0,9	0,9	0,8	0,2
R 60			0,6	0,6	0,6	0,2	0,9	0,9	0,7	0,2
R 90			0,5	0,6	0,6	0,1	0,9	0,9	0,6	0,1
R 120			0,4	0,5	0,5	0,1	0,7	0,7	0,6	0,1
R 30 - R 120	Edge distance	$C_{cr,fi}$ [mm]	50				50			
	Spacing	$S_{cr,fi}$ [mm]	100				100			
Shear load with lever arm										
R 30	Characteristic resistance, steel zinc plated	$M^0_{Rk,fi}$ [Nm]	0,7	1,0	0,7	2)	0,7	1,0	0,7	2)
R 60			0,5	0,8	0,7	2)	0,5	0,8	0,7	2)
R 90			0,4	0,5	0,6	2)	0,4	0,5	0,6	2)
R 120			0,3	0,4	0,5	2)	0,3	0,4	0,5	2)
R 30	Characteristic resistance, stainless steel A4 / HCR	$M^0_{Rk,fi}$ [Nm]	1,4	2,1	0,7	2)	1,4	2,1	0,7	2)
R 60			1,1	1,5	0,7	2)	1,1	1,5	0,7	2)
R 90			0,7	1,0	0,6	2)	0,7	1,0	0,6	2)
R 120			0,5	0,7	0,5	2)	0,5	0,7	0,5	2)
If the fire attack is from more than one side, the edge distance shall be ≥ 300 mm										

¹⁾ A fixing point is defined as:

- Single fastener,
- Fastener group with a minimum spacing s of $50 \text{ mm} \leq s < S_{cr}$

If the spacing in a fixing point is greater than or equal to the respective spacing in this table, the characteristic resistances apply to every single fastener

²⁾ No performance assessed

³⁾ Only in connection with threaded rods M8, M10 or M12 minimum strength class 5.8.

Nail Anchor N

Performances

Characteristic resistance under fire exposure

Annex C2